
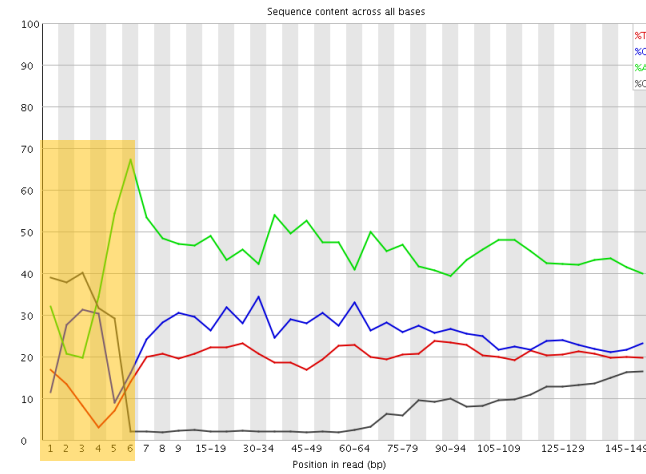


# Cow RRBS data assessment



26 July 2018

# Sequence composition: data is directional, but does not look like RRBS

before trimming

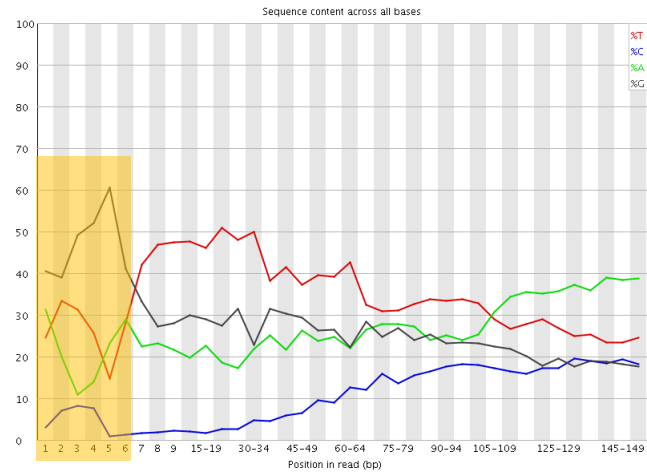

after trimming  
(removing 6bp from 5' end,  
Illumina adapter)

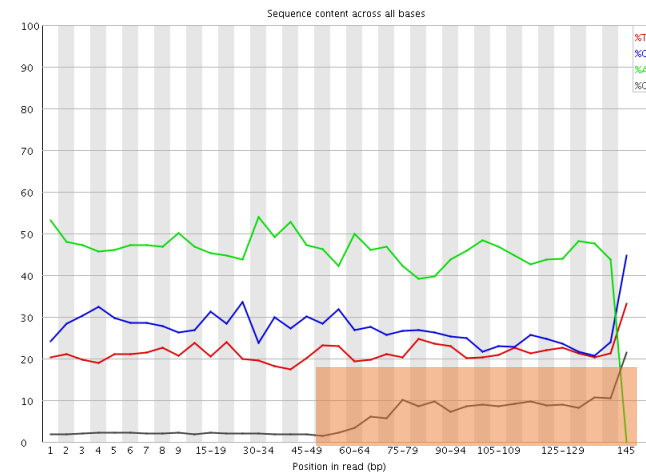
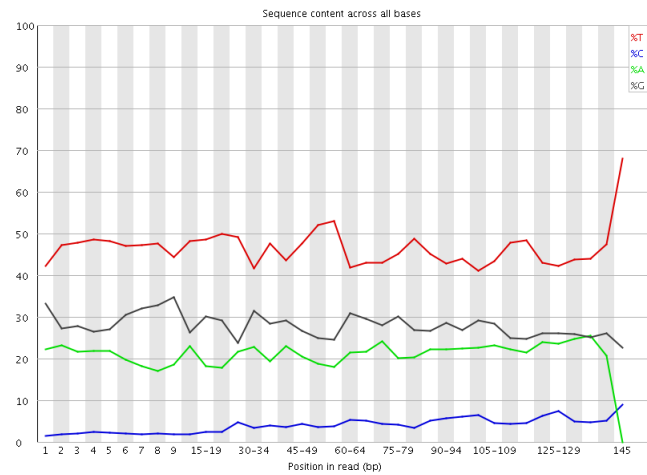


Read1


Read2

# Adapter read-through contamination: only Read 1 heavily affected


before trimming

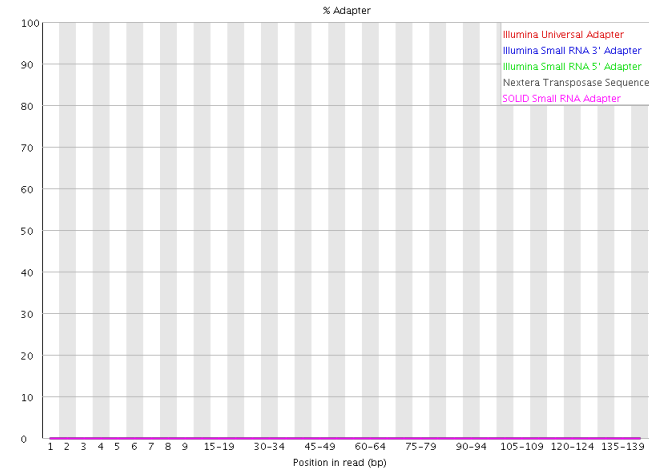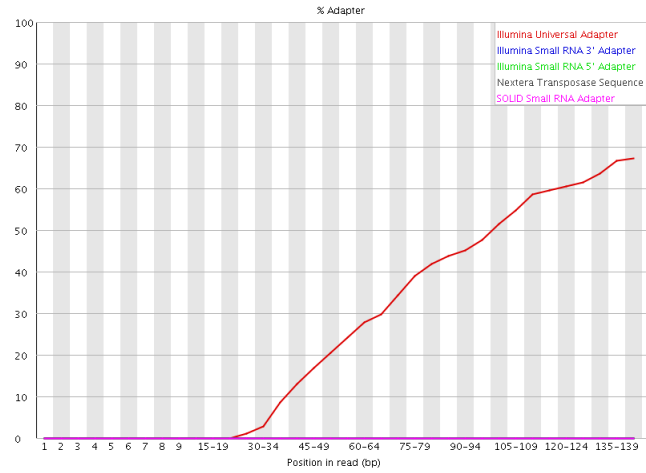

after trimming  
(removing 6bp from 5' end,  
Illumina adapter)

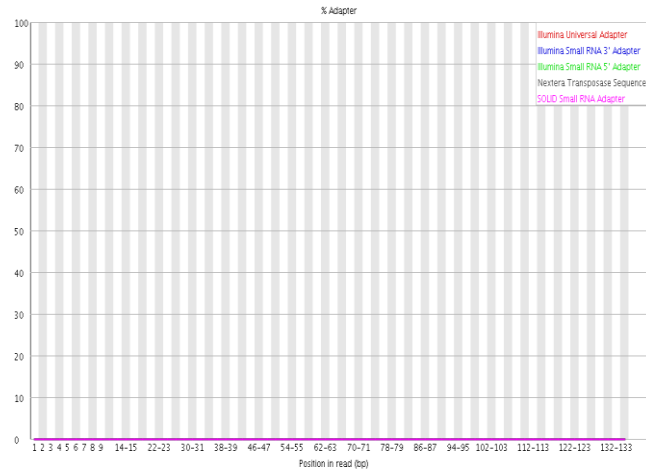

Read1

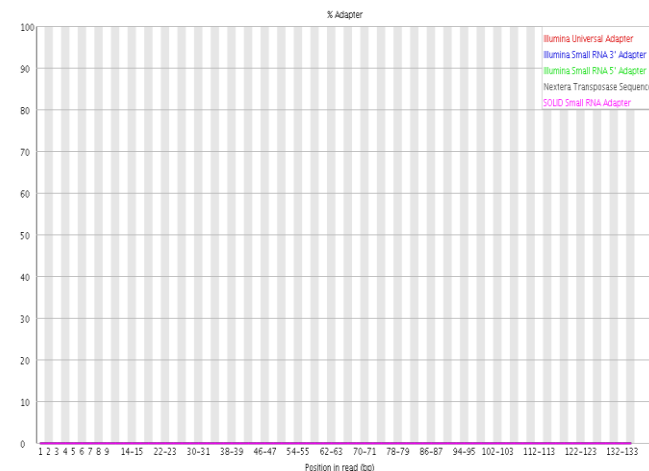

Read2